

ADDENDUM NO. 1

TO: ALL PLAN HOLDERS

RE: Freeo Creek Water Line Relocation – Harmony Grove Water Association


ADDENDUM DATE: May 29, 2024

The Plans, Specifications and Contract Documents for the above referenced project are hereby modified as follows:

1. **Bid Proposal: Add the additional Bid Item #15 to the bid proposal. See attached page 9.**
2. **See the plans sheets attached for Bid Item #15.**

ADDENDUM NO.1 ISSUED BY:

A.L. FRANKS ENGINEERING


Cody Stringer, P.E.
Project Manager




BID PROPOSAL CONTINUED

ITEM	QTY	UNIT	DESCRIPTION	UNIT	TOTAL
15	1	L.S.	Clear and grub as necessary for installation of new water main at a minimum width 10' per the plans and specifications for the lump sum price of	\$ _____	\$ _____
			_____ Dollars and _____ Cents/L.S.		
TOTAL OF ALL ITEMS				\$ _____	



NOTES

- 1) Miscellaneous items, directed work, connections, etc., not specifically listed but required to complete the proposed improvements to a complete and operational system shall be included in the Bid under the most appropriate Bid Item.
- 2) Time required to complete base bid work shall be 360 calendar days.
- 3) Contractor is to perform and adhere to all requirements of the Storm Water Pollution Prevention Plan found in Exhibit "A" of the Technical Specs.
- 4) Contractor is solely responsible for the complete abandonment of all existing mains unless otherwise noted.

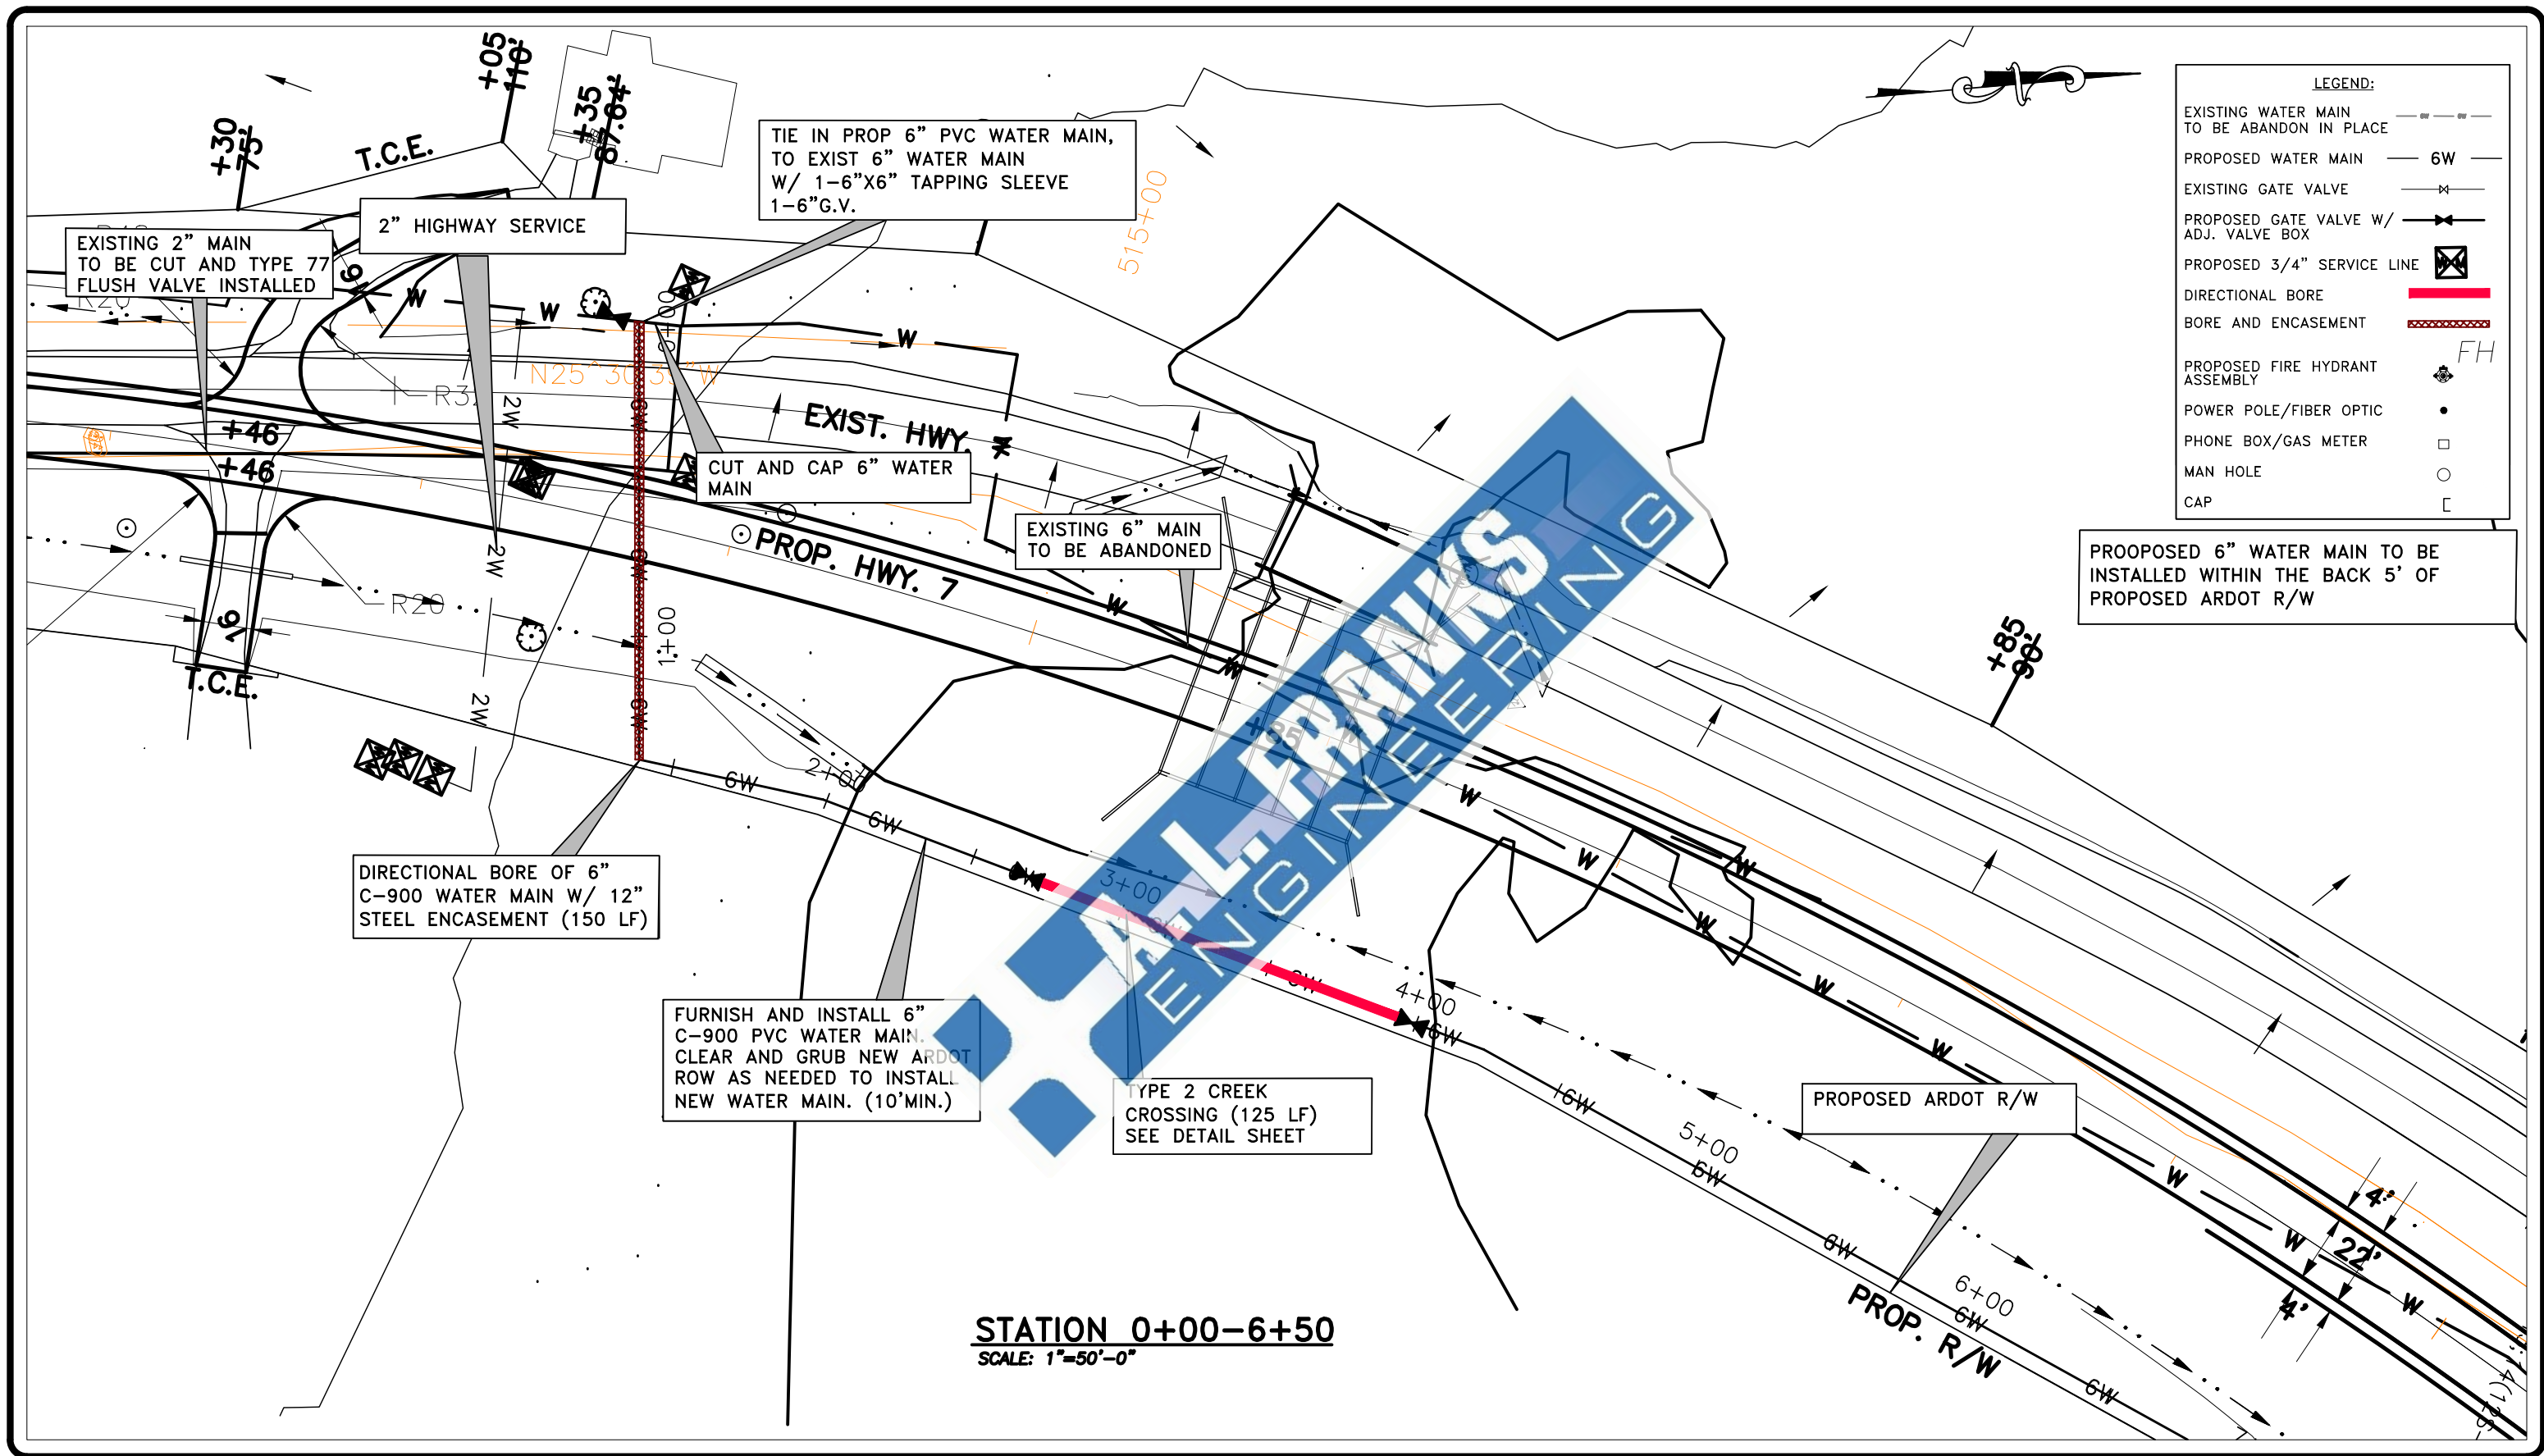

LEGEND:

EXISTING WATER MAIN TO BE ABANDON IN PLACE	---
PROPOSED WATER MAIN	6W
EXISTING GATE VALVE	⊗
PROPOSED GATE VALVE W/ ADJ. VALVE BOX	⊗
PROPOSED 3/4" SERVICE LINE	⊗
DIRECTIONAL BORE	—
BORE AND ENCASEMENT	—
PROPOSED FIRE HYDRANT ASSEMBLY	FH
POWER POLE/FIBER OPTIC	•
PHONE BOX/GAS METER	□
MAN HOLE	○
CAP	⌈

PROPOSED 6" WATER MAIN TO BE INSTALLED WITHIN THE BACK 5' OF PROPOSED ARDOT R/W

STATION 0+00-6+50
SCALE: 1"=50'-0"

Date	Revision	By

Designed	CJS
Checked	KSB
Drawn	CJS
Approved	KSB

A.L. FRANKS ENGINEERING


118 East Broad Street
Texarkana, Arkansas 71854
Phone (870) 216-1906
Fax (870) 216-1907

107 OUACHITA 426
CAMDEN, ARKANSAS 71701
PHONE (870) 574-2522

HARMONY GROVE WATER ASSOCIATION
FREEO CREEK WATER LINE RELOCATION
STATION 0+00-6+50

STATE OF ARKANSAS
REGISTERED PROFESSIONAL ENGINEER
ANTHONY L. FRANKS
No. 9192

Job No.: HA-01-22
Scale: 1"=50'
Date: NOVEMBER 2022
Sheet 4 OF 9

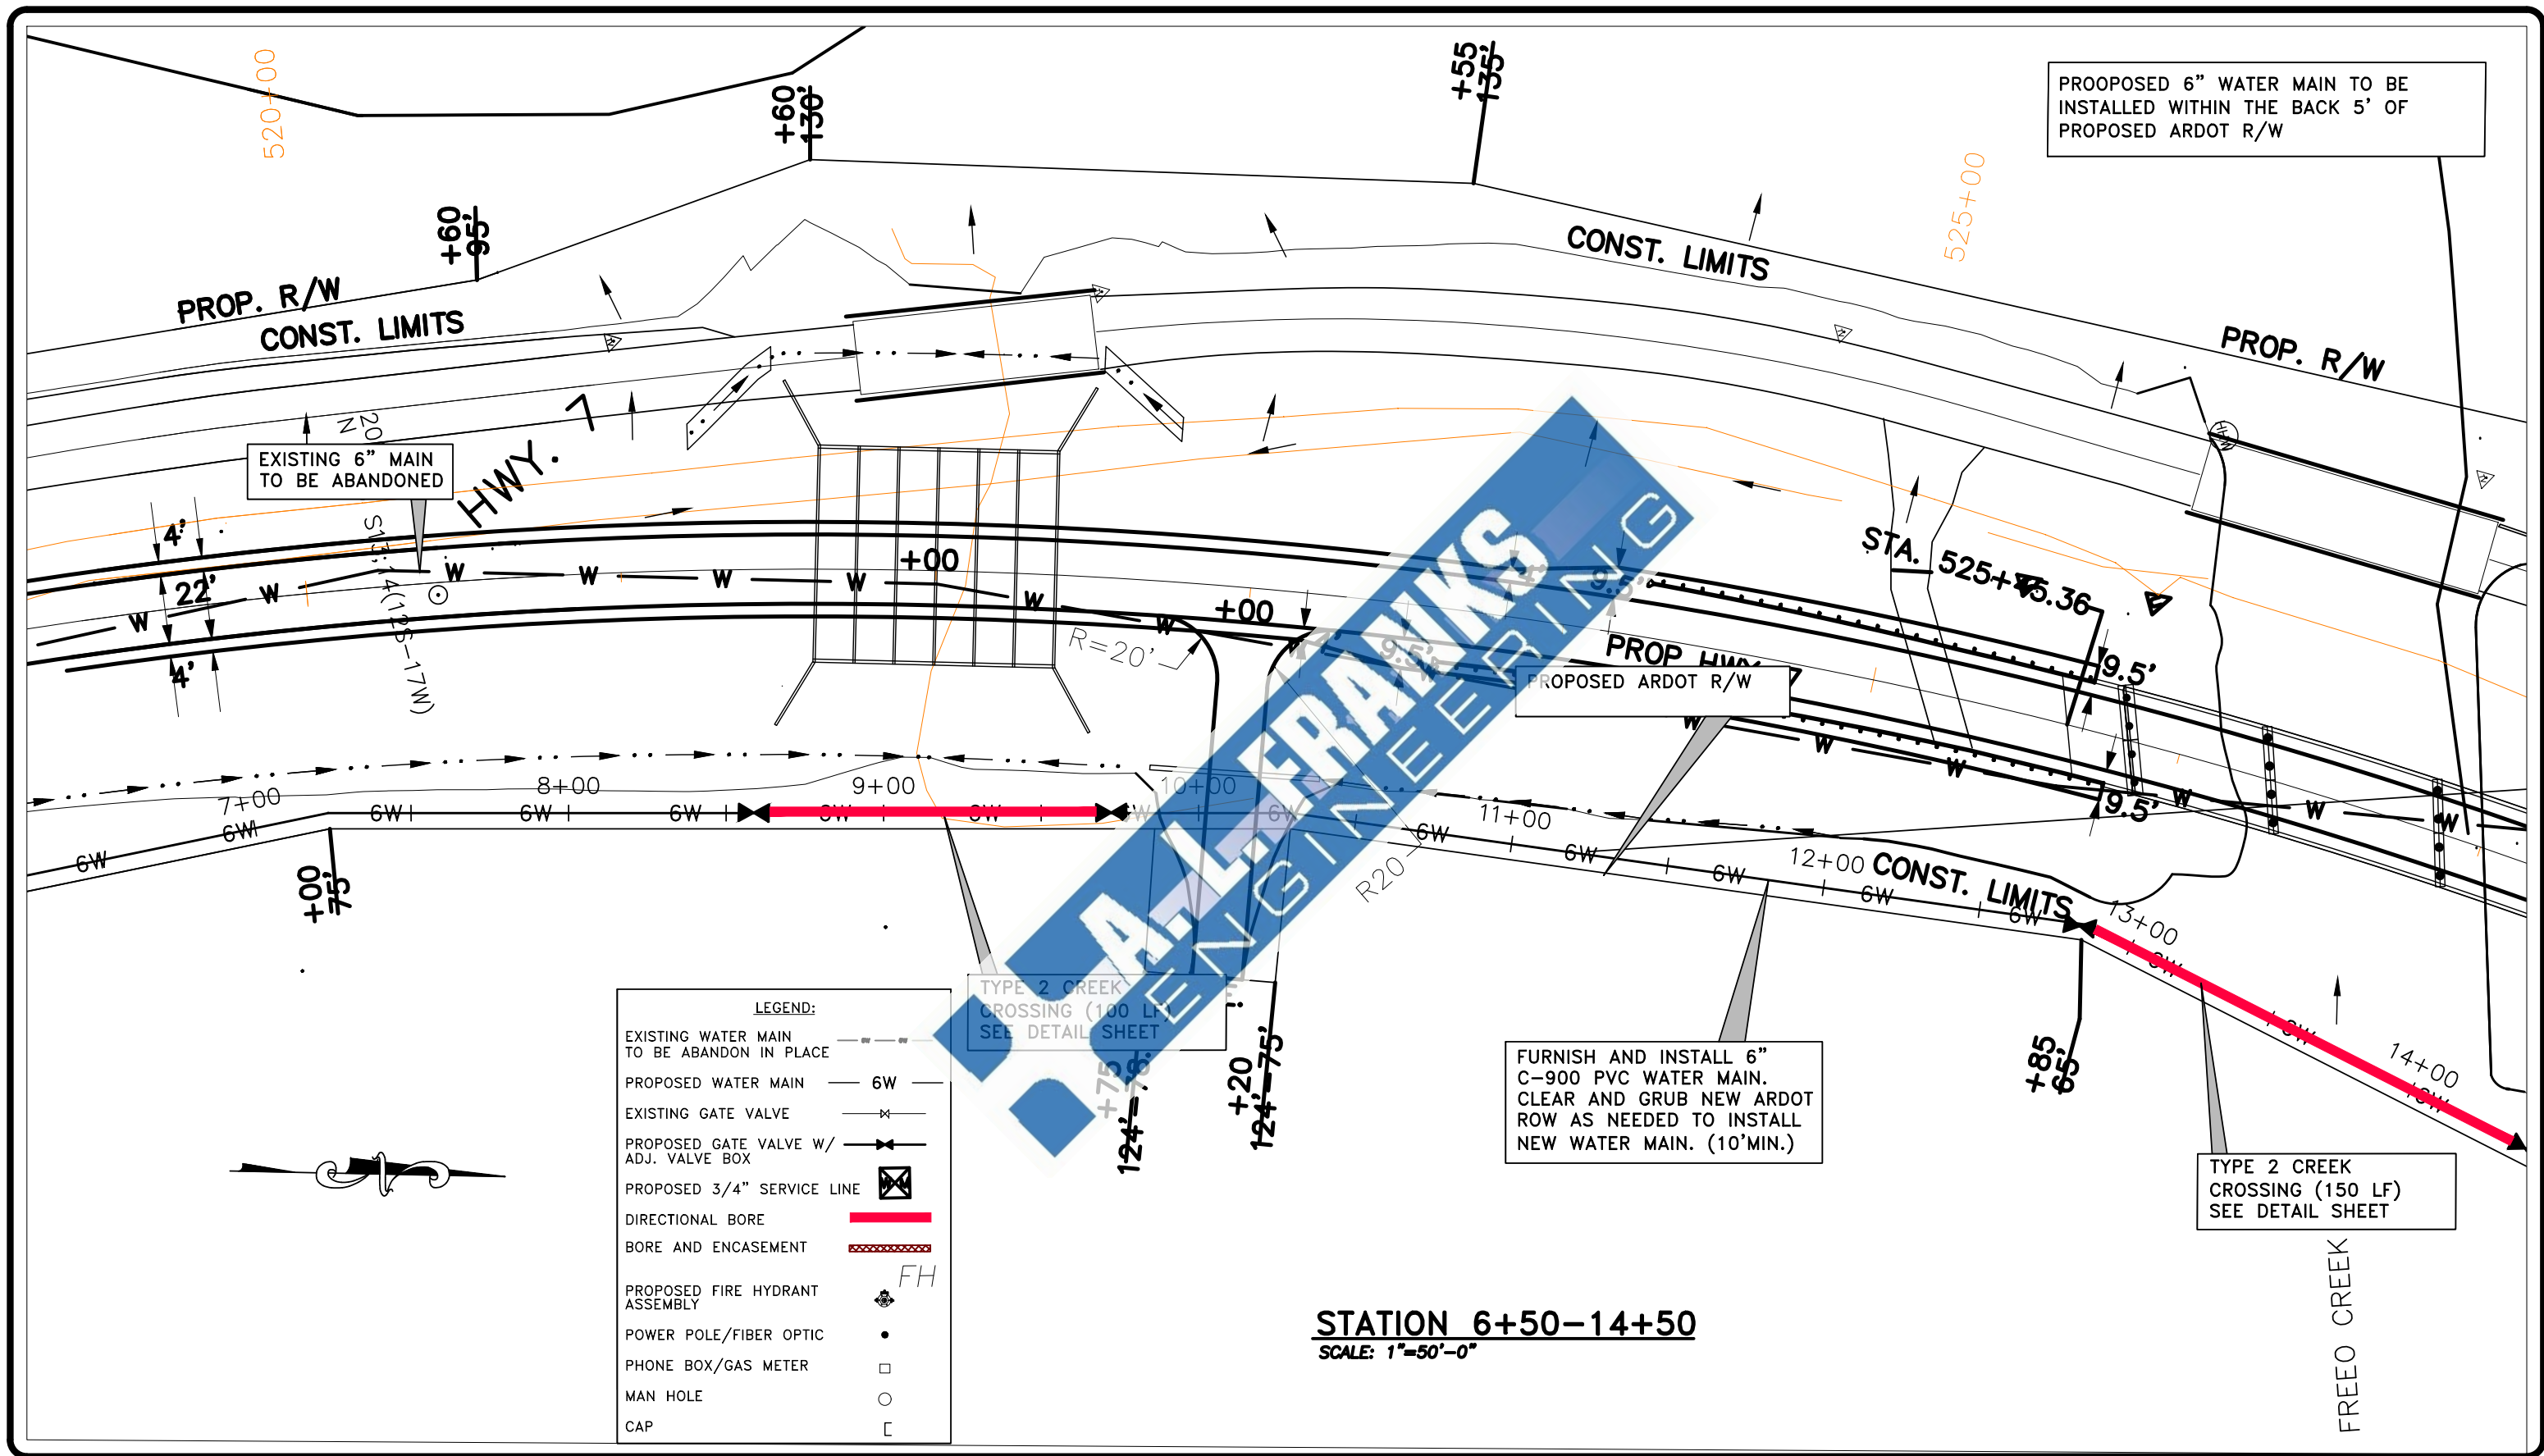

PROPOSED 6" WATER MAIN TO BE INSTALLED WITHIN THE BACK 5' OF PROPOSED ARDOT R/W

EXISTING 6" MAIN TO BE ABANDONED

FURNISH AND INSTALL 6" C-900 PVC WATER MAIN. CLEAR AND GRUB NEW ARDOT ROW AS NEEDED TO INSTALL NEW WATER MAIN. (10'MIN.)

TYPE 2 CREEK CROSSING (150 LF) SEE DETAIL SHEET

LEGEND:

EXISTING WATER MAIN TO BE ABANDON IN PLACE	---
PROPOSED WATER MAIN	6W
EXISTING GATE VALVE	⊗
PROPOSED GATE VALVE W/ ADJ. VALVE BOX	⊗
PROPOSED 3/4" SERVICE LINE	⊗
DIRECTIONAL BORE	—
BORE AND ENCASEMENT	⊗
PROPOSED FIRE HYDRANT ASSEMBLY	FH
POWER POLE/FIBER OPTIC	•
PHONE BOX/GAS METER	□
MAN HOLE	○
CAP	⌈

STATION 6+50-14+50
SCALE: 1"=50'-0"

Date	Revision	By


Designed	CJS
Checked	KSB
Drawn	CJS
Approved	KSB



118 East Broad Street
Texarkana, Arkansas 71854
Phone (870) 216-1906
Fax (870) 216-1907

107 OUACHITA 426
CAMDEN, ARKANSAS 71701
PHONE (870) 574-2522


HARMONY GROVE WATER ASSOCIATION
FREEO CREEK WATER LINE RELOCATION
STATION 6+50-14+50



Job No.: HA-01-22
Scale: 1"=50'
Date: NOVEMBER 2022
Sheet 5 OF 9

LEGEND:

EXISTING WATER MAIN TO BE ABANDON IN PLACE	---
PROPOSED WATER MAIN 6W	— 6W —
EXISTING GATE VALVE	⊗
PROPOSED GATE VALVE W/ ADJ. VALVE BOX	⊗
PROPOSED 3/4" SERVICE LINE	⊗
DIRECTIONAL BORE	—
BORE AND ENCASMENT	⊗
PROPOSED FIRE HYDRANT ASSEMBLY	FH
POWER POLE/FIBER OPTIC	•
PHONE BOX/GAS METER	□
MAN HOLE	○
CAP	⌈

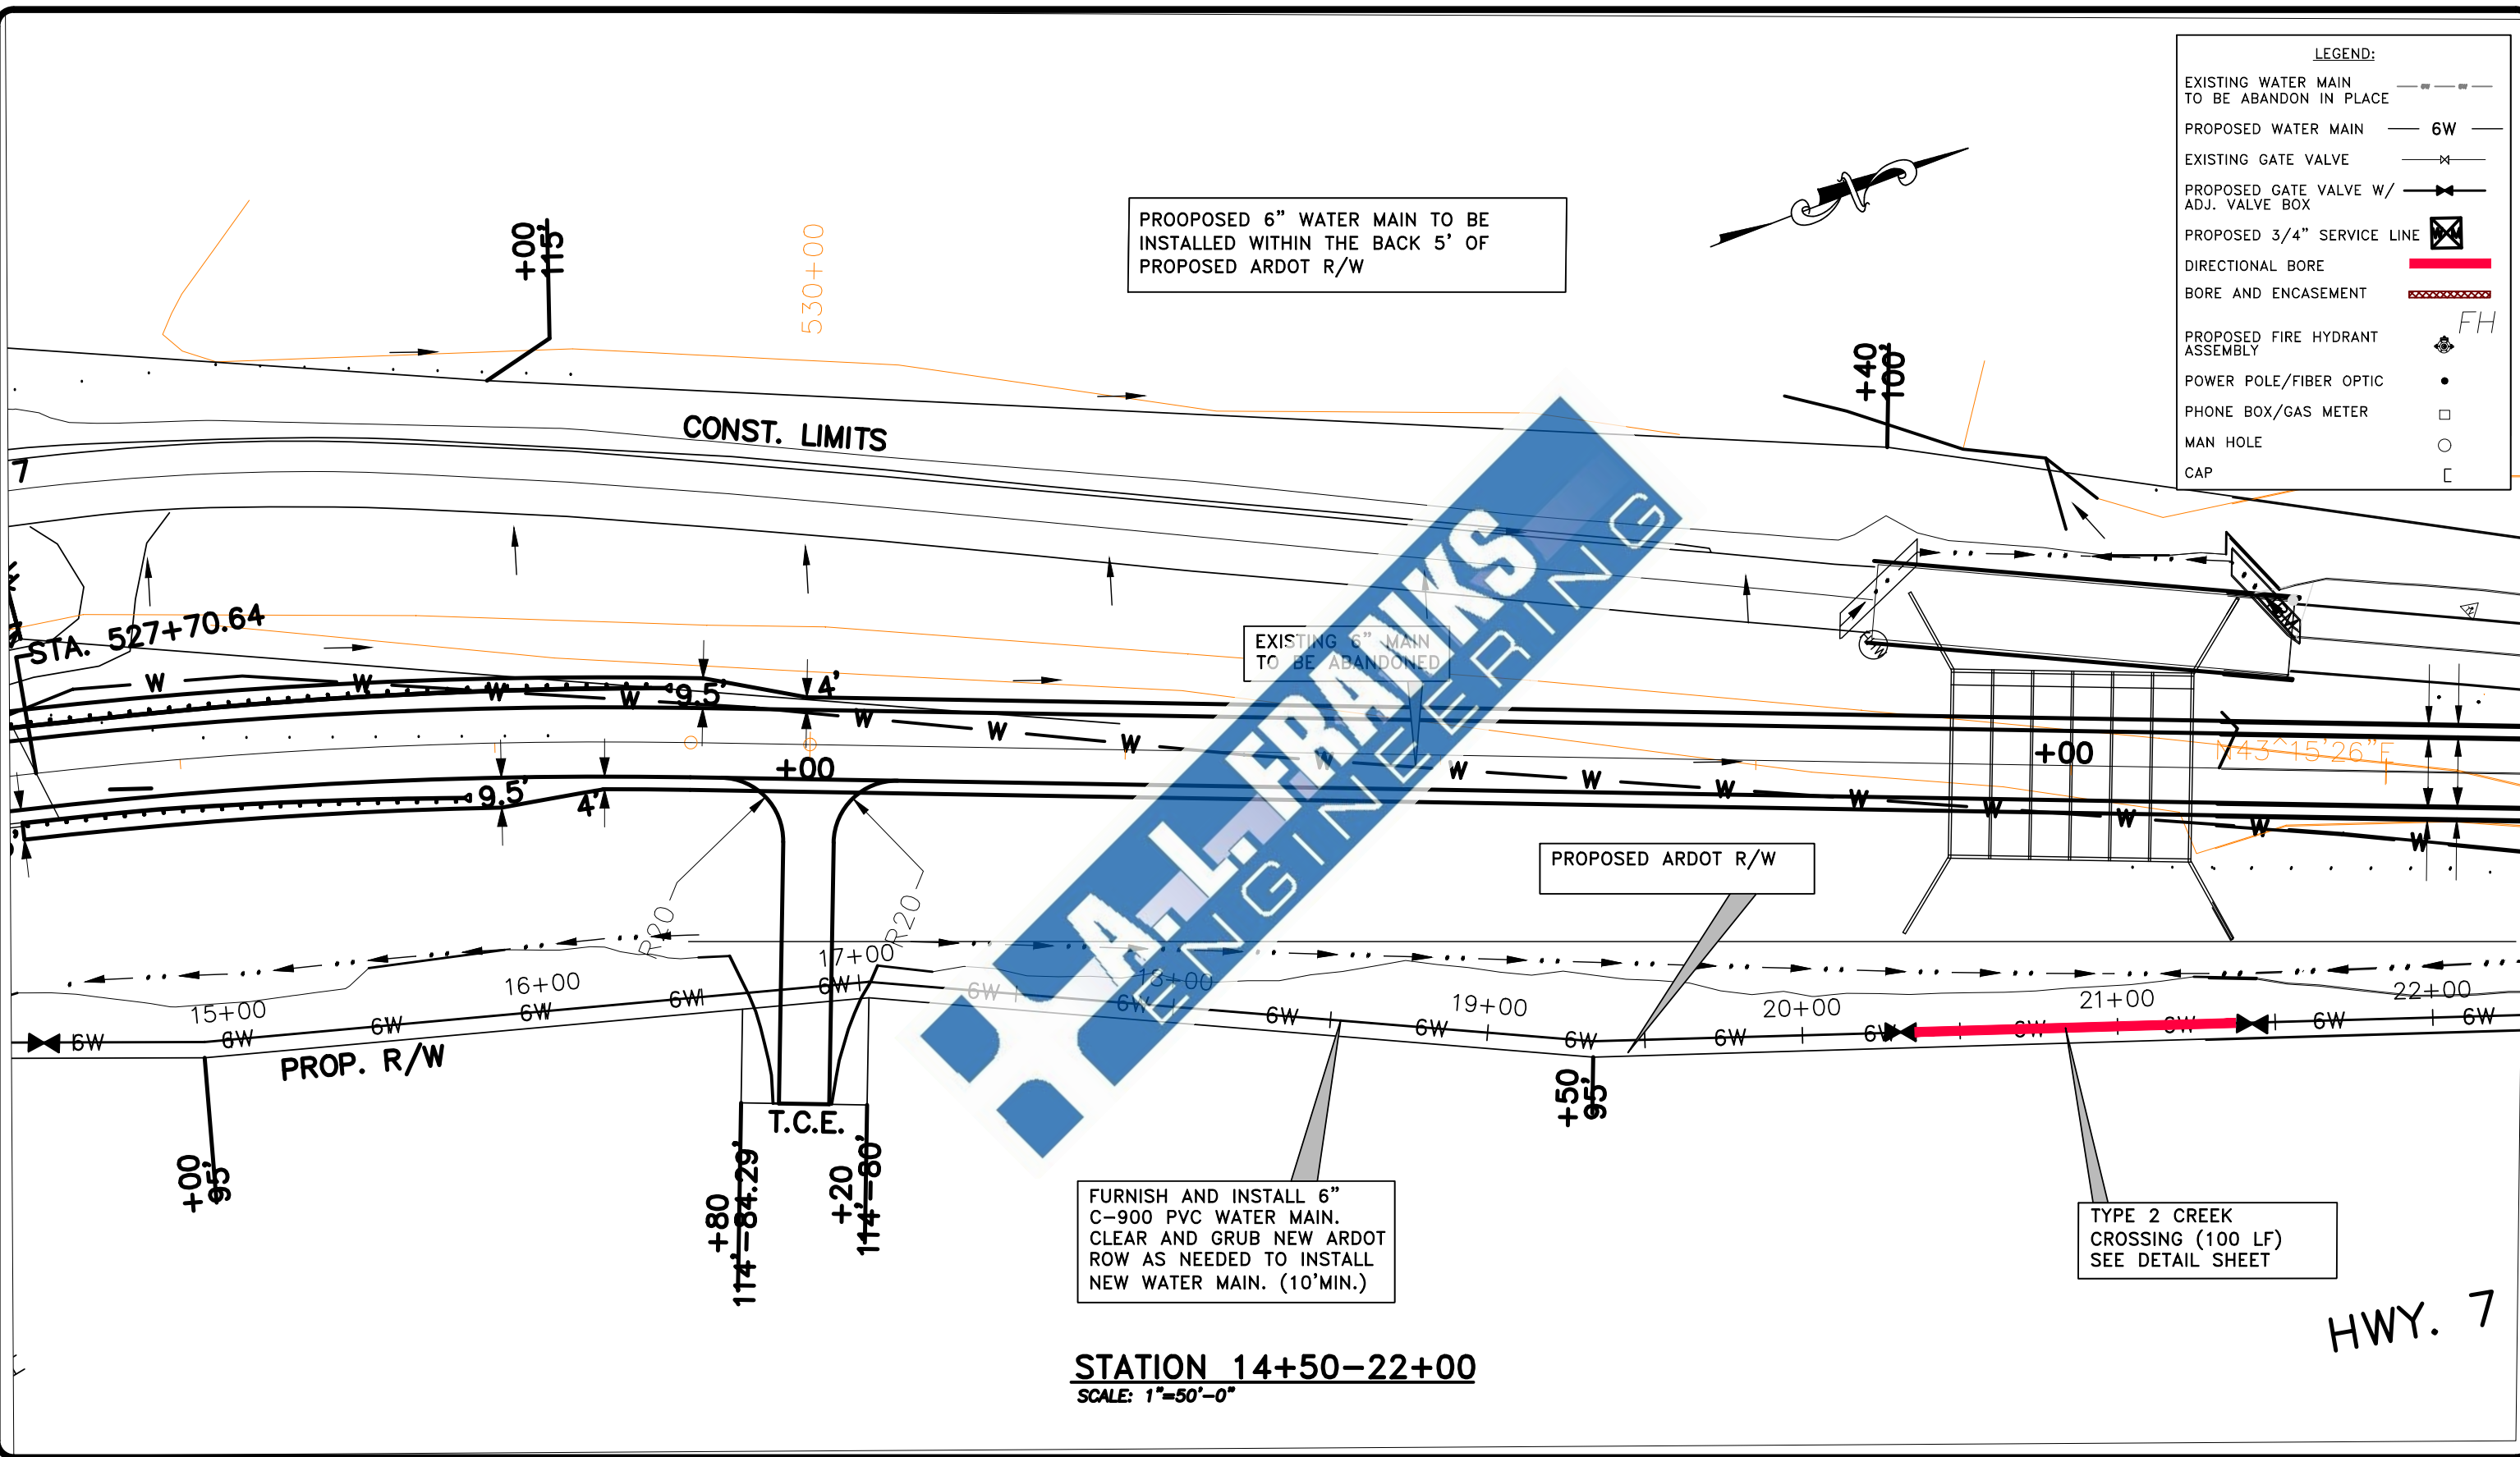

PROPOSED 6" WATER MAIN TO BE INSTALLED WITHIN THE BACK 5' OF PROPOSED ARDOT R/W

EXISTING 6" MAIN TO BE ABANDONED

PROPOSED ARDOT R/W

FURNISH AND INSTALL 6" C-900 PVC WATER MAIN. CLEAR AND GRUB NEW ARDOT ROW AS NEEDED TO INSTALL NEW WATER MAIN. (10'MIN.)

TYPE 2 CREEK CROSSING (100 LF) SEE DETAIL SHEET

STATION 14+50-22+00
SCALE: 1"=50'-0"

HWY. 7

Date	Revision	By

Designed	CJS
Checked	KSB
Drawn	CJS
Approved	KSB

A.L. FRANKS ENGINEERING

118 East Broad Street
Texarkana, Arkansas 71854
Phone (870) 216-1906
Fax (870) 216-1907

107 OUACHITA 426
CAMDEN, ARKANSAS 71701
PHONE (870) 574-2522

HARMONY GROVE WATER ASSOCIATION
FREEO CREEK WATER LINE RELOCATION
STATION 14+50-22+00


STATE OF ARKANSAS
REGISTERED PROFESSIONAL ENGINEER
ANTHONY L. FRANKS
No. 9192

Job No.: HA-01-22
Scale: 1"=50'
Date: NOVEMBER 2022
Sheet 6 OF 9

LEGEND:

EXISTING WATER MAIN TO BE ABANDON IN PLACE	---
PROPOSED WATER MAIN	6W
EXISTING GATE VALVE	⊗
PROPOSED GATE VALVE W/ ADJ. VALVE BOX	⊗
PROPOSED 3/4" SERVICE LINE	⊗
DIRECTIONAL BORE	—
BORE AND ENCASEMENT	—
PROPOSED FIRE HYDRANT ASSEMBLY	FH
POWER POLE/FIBER OPTIC	•
PHONE BOX/GAS METER	□
MAN HOLE	○
CAP	⊔

PROPOSED 6" WATER MAIN TO BE INSTALLED WITHIN THE BACK 5' OF PROPOSED ARDOT R/W

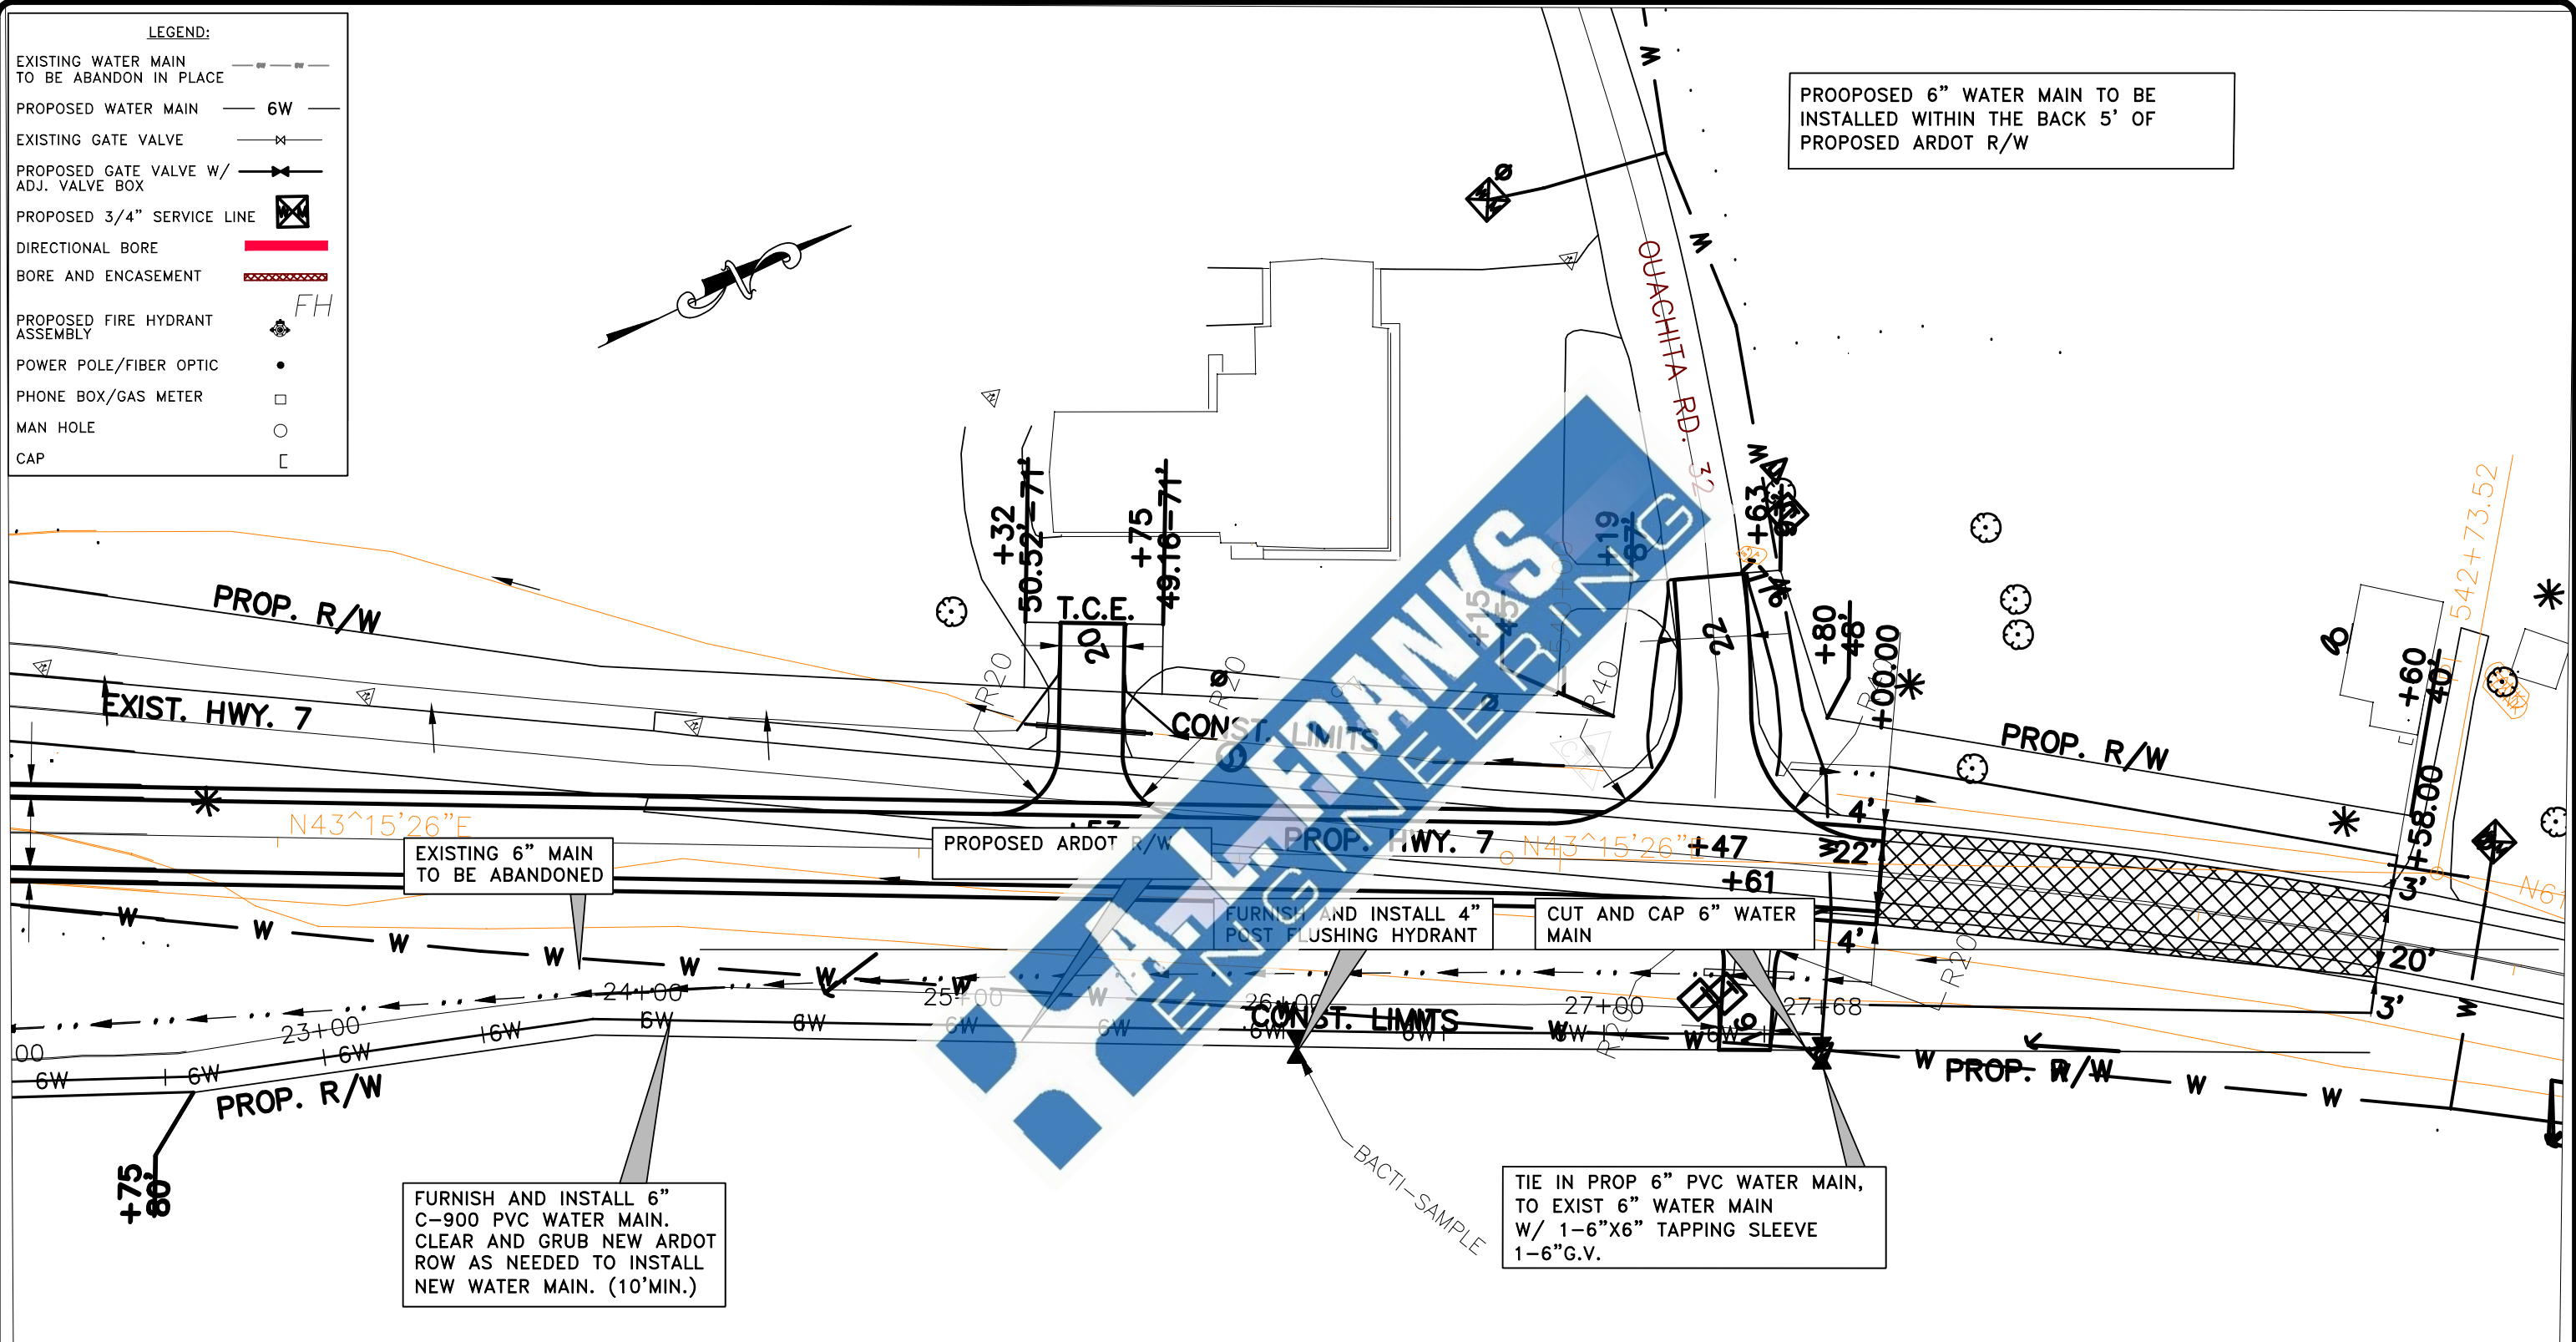

EXISTING 6" MAIN TO BE ABANDONED

FURNISH AND INSTALL 6" C-900 PVC WATER MAIN. CLEAR AND GRUB NEW ARDOT ROW AS NEEDED TO INSTALL NEW WATER MAIN. (10'MIN.)

FURNISH AND INSTALL 4" POST FLUSHING HYDRANT

CUT AND CAP 6" WATER MAIN

TIE IN PROP 6" PVC WATER MAIN, TO EXIST 6" WATER MAIN W/ 1-6"X6" TAPPING SLEEVE 1-6"G.V.

7

STATION 22+00-27+68
SCALE: 1"=50'-0"

Date	Revision	By

Designed	CJS
Checked	KSB
Drawn	CJS
Approved	KSB

A.L. FRANKS ENGINEERING

118 East Broad Street
Texarkana, Arkansas 71854
Phone (870) 216-1906
Fax (870) 216-1907

107 OUACHITA 426
CAMDEN, ARKANSAS 71701
PHONE (870) 574-2522

HARMONY GROVE WATER ASSOCIATION
FREEO CREEK WATER LINE RELOCATION
STATION 22+00-27+68

STATE OF ARKANSAS REGISTERED PROFESSIONAL ENGINEER ANTHONY L. FRANKS No. 9192

Job No.: HA-01-22
Scale: 1"=50'
Date: NOVEMBER 2022
Sheet 7 OF 9